

Germantown


Fire Department

**Monthly Report
August 2024**




**John Delain
Fire Chief**

RESPONSE

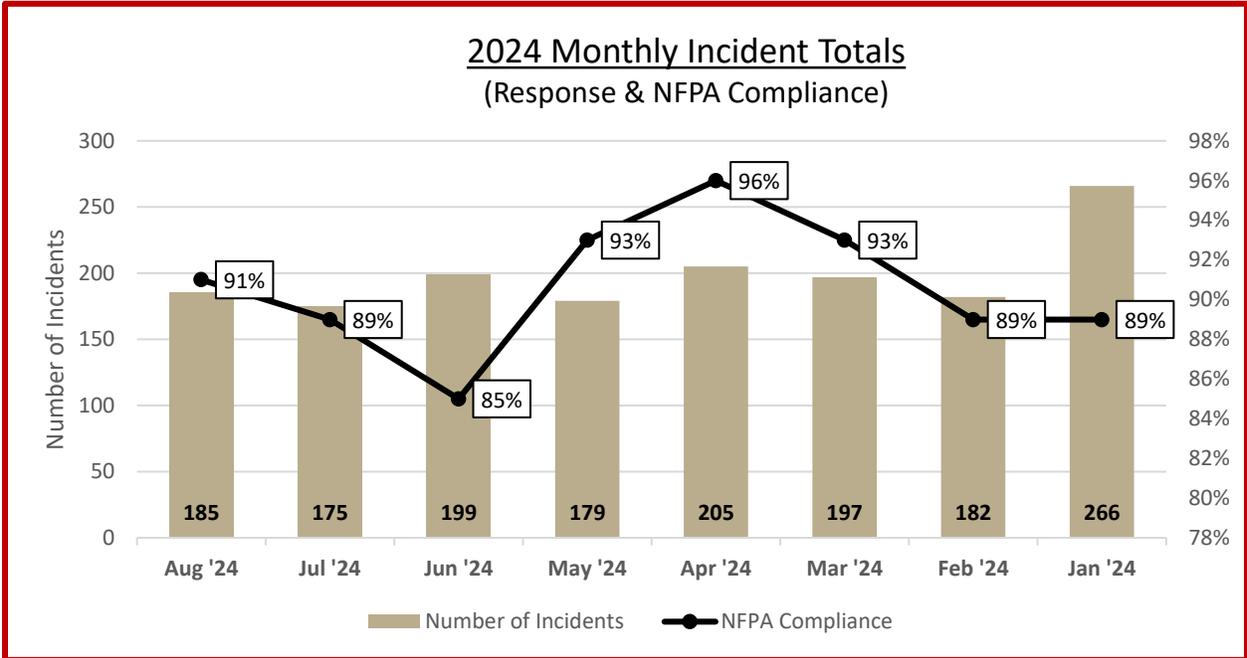


Performance Target: Arrival of crews within 8 minutes according to NFPA 1710 standard, and within 5:20 minutes per ISO Guidelines (NFPA standard is 90%).

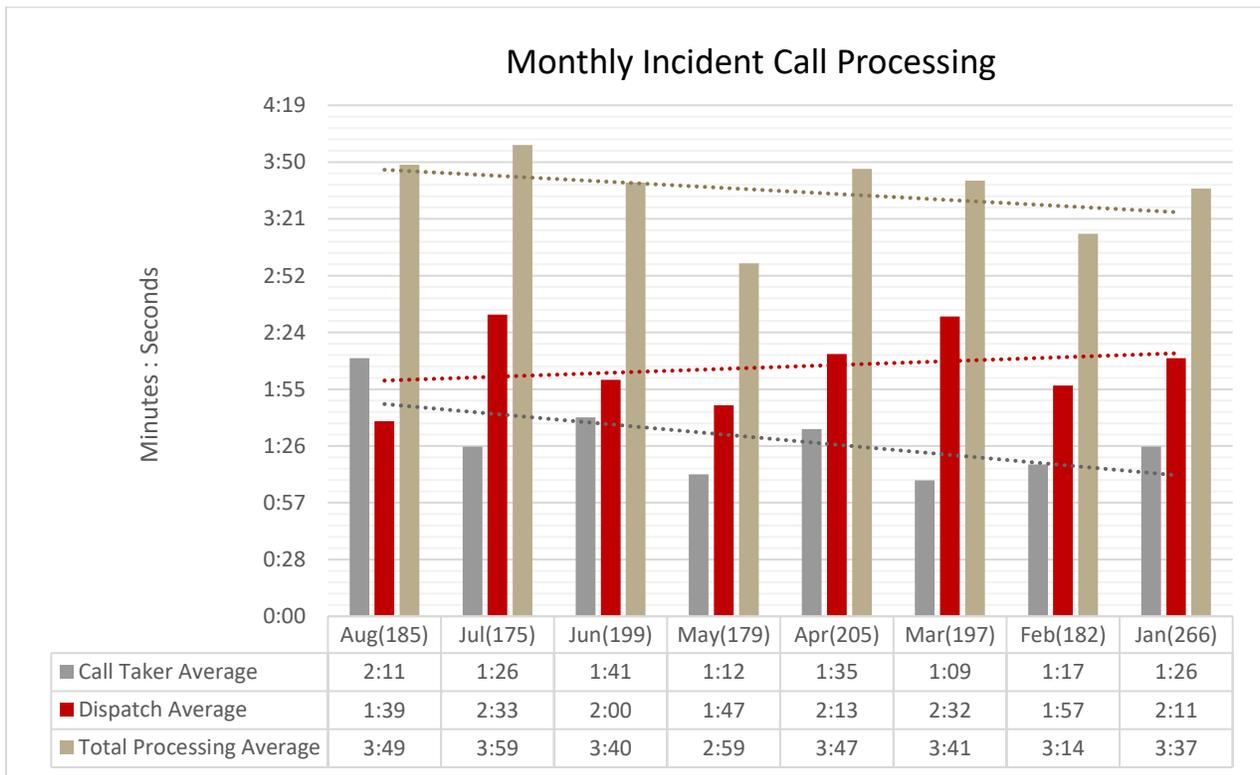


INCIDENTS


AUG - Calls by Time of Day

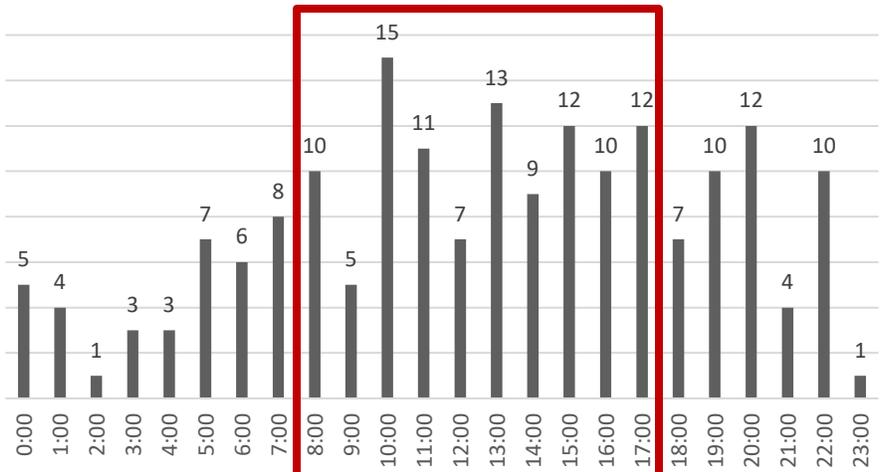


AUG - Calls by Day of Week

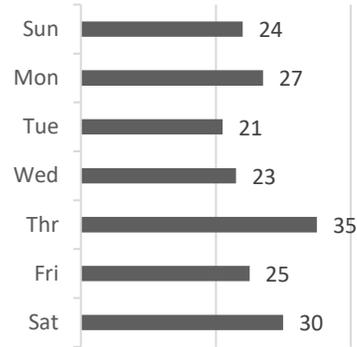

Monthly EMS Calls (non-MVA)

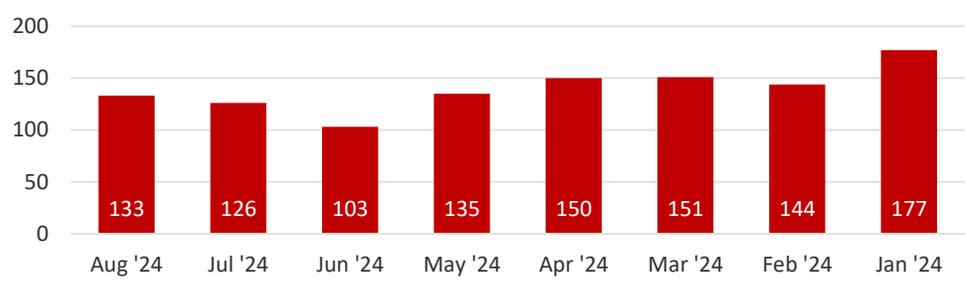

AUG HOSPITAL TRANSPORTS = 132

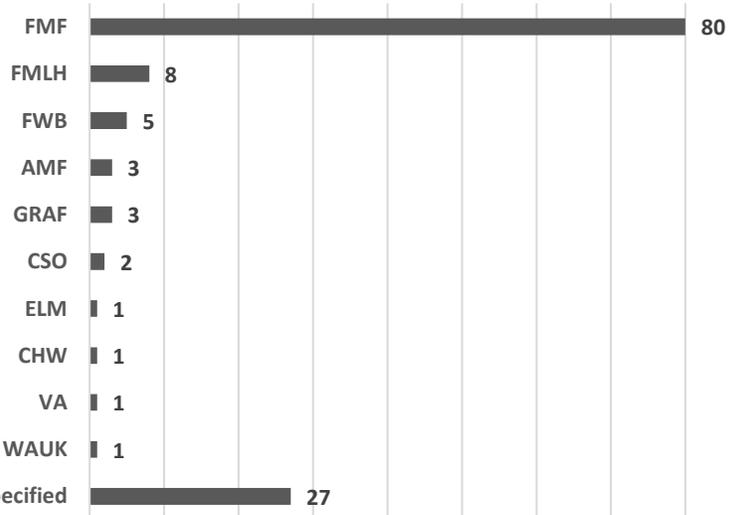


Location Details:

- AMF Ascension Falls
- CHW Children's
- CSO Columbia St Mary's Ozaukee
- FMF Froedtert Falls
- FMLH Froedtert Main
- FMQ Froedtert Mequon
- FWB Froedtert West Bend
- GRAF Aurora Grafton
- VA VA Hospital
- ELM Elmbrook Brookfield
- WAUK Waukesha Memorial

INCIDENTS

Call volume “Heat Map” indicating incidents in the Village by Zone.

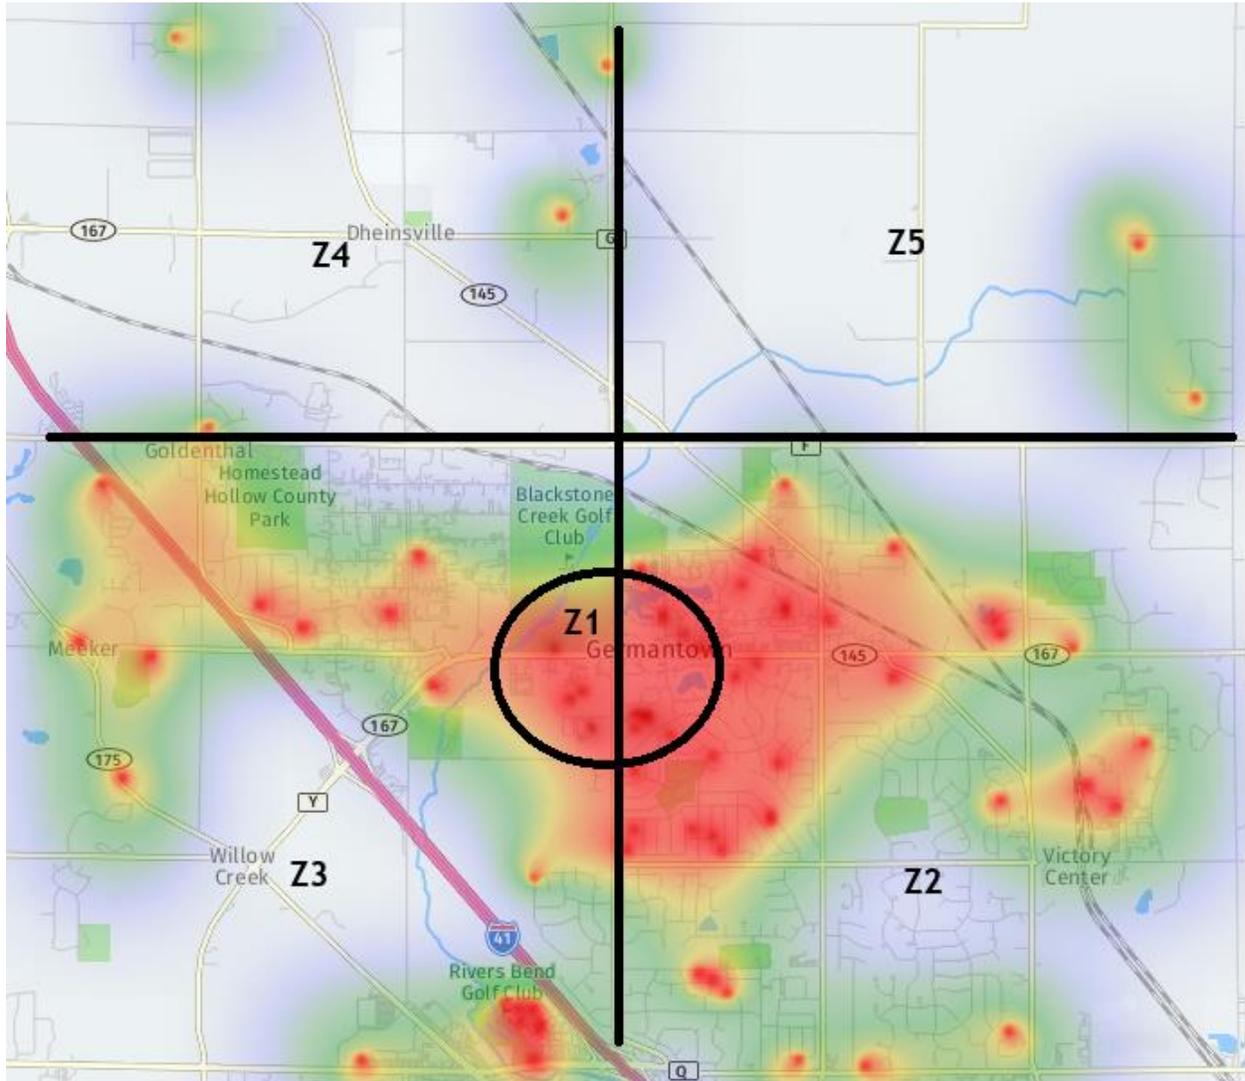

Districts Responded


	AUGUST 2024
District	# incidents
ZONE 1: GFV-Gables, Fairway Knoll, Virginia Highlands, Frontida	39
ZONE 2: SE-Southeast	80
ZONE 3: SW-Southwest	43
ZONE 4: NW-Northwest	8
ZONE 5: NE-Northeast	4
OUT-All areas outside the Village of Germantown	3
Total	177

INCIDENTS

NFIRS Incident Type	AUGUST 2024
Incident Type Group	# of Incident
111 -Building fire	1
138 -Off-road vehicle or heavy equipment fire	1
300 -Rescue, emergency medical call (EMS) call, other	7
321 -EMS call, excluding vehicle accident with injury	133
322 -Vehicle accident with injuries	8
324 -Motor vehicle accident with no injuries.	3
353 -Removal of victim(s) from stalled elevator	1
412 -Gas leak (natural gas or LPG)	1
424 -Carbon monoxide incident	2
445 -Arcing, shorted electrical equipment	1
554 -Assist invalid	2
561 -Unauthorized burning	2
611 -Dispatched & canceled en route	5
631 -Authorized controlled burning	1
700 -False alarm or false call, other	2
731 -Sprinkler activation due to malfunction	2
733 -Smoke detector activation due to malfunction	2
735 -Alarm system sounded due to malfunction	1
740 -Unintentional transmission of alarm, other	2
743 -Smoke detector activation, no fire - unintentional	4
744 -Detector activation, no fire - unintentional	1
745 -Alarm system sounded, no fire - unintentional	1
746 -Carbon monoxide detector activation, no CO	1
900 -Special type of incident, other	1

NFIRS Mutual Aid Summary Report		AUGUST 2024	
Mutual Aid Type	Received From/Given To	# incidents	# units
Mutual aid given	City Of Mequon Fire Department	1	2
	Richfield Volunteer Fire Company	1	1
	Thiensville Volunteer Fire Department	1	1
	Total :	3	4
Mutual aid received	Jackson Fire Department	1	1
	Menomonee Falls Fire Department	3	5
	Richfield Volunteer Fire Company	2	3
	Thiensville Volunteer Fire Department	1	1
	Total :	6	10
Grand total :		9	14

INSPECTIONS

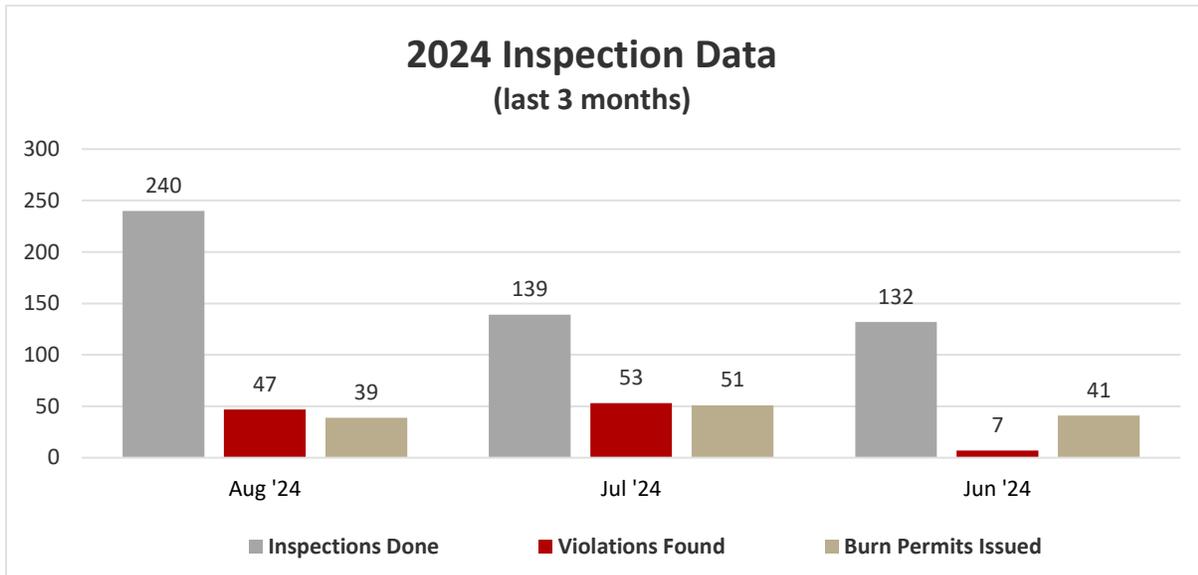

PUBLIC EDUCATION

AUGUST:

- (2) GFD Department Training
- (2) Post 17 Explorers Training
- CPR/AED/First Aid training (2)
- Waste Management training at Station 2 (3 days, 2 hours each)
- NAC Night
- Learn Not to Burn
- Moose Lodge - Truck Display
- HOCPR/AED at Station 2 (40 students over 2 days)
- Ride Along (3)
- HOCPR/AED off-site (12)
- Fire Extinguisher Training (10)
- Touch-A-Truck Day at Fleet Farm